# [1] **TYPE EXAMINATION CERTIFICATE** - Translation

[2] Equipment of equipment-groups I and II, equipment-categories M2 and 2 plus 3



- [3] Type examination certificate number IBExU17ATEXB007 X | Issue 0
- [4] Product: Sample Gas Probe Type: GAS 222.xx Ex2
- [5] Manufacturer: Bühler Technologies GmbH
- [6] Address: Harkortstr. 29 40880 Ratingen GERMANY
- [7] This product and any acceptable variation thereto is specified in the schedule to this certificate and the documents therein referred to.
- [8] IBExU Institut für Sicherheitstechnik GmbH certifies that this product has been found to comply with the essential health and safety requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II to Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014.

The examination and test results are recorded in the confidential test report IB-16-3-053.

- [9] Compliance with the essential health and safety requirements has been assured by compliance with: EN 60079-0:2012 + A11:2013 EN 60079-7:2015 except in respect of those requirements listed at item [18] of the schedule.
- [10] If the sign "X" is placed after the certificate number, it indicates that the product is subject to the specific conditions of use specified in the schedule to this certificate.
- [11] This type examination certificate relates only to the design of the specified equipment and not to specific items of equipment subsequently manufactured or supplied.
- [12] The marking of the product shall include the following:

## 🐵 II 3G Ex ec ic mb IIC T3/T4 Gc

IBExU Institut für Sicherheitstechnik GmbH Fuchsmühlenweg 7 09599 Freiberg, GERMANY

By order

1. Hert

Dipl.-Ing. [FH] A. Henker

IBEXU Institut für Sicherheitstechnik GmbH Fuchsmühlenweg 7 09599 Freiberg/Sachsen Telefon (03731) 3805-0 Telefax (03731) 38 05 10

- Stamp -

Tel: + 49 (0) 37 31 / 38 05 0 Fax: + 49 (0) 37 31 / 38 05 10

Certificates without signature and stamp are not valid. Certificates may only be duplicated completely and unchanged. In case of dispute, the German text shall prevail.

Freiberg, 2017-08-24

[13]

[14]

### Schedule


#### Certificate number IBExU17ATEXB007 X | Issue 0

#### [15] **Description of product**

At the gas analysis the sampling point is a critical interface between the process and the analysis system. The probes are used to take gas samples from a sampling point. They can be unheated or heated. The probes are equipped with an in-situ filter or a downstream filter or with a combination of both. Some probes have an integrated shut off ball valve (manual or pneumatic) for the blowback of the filter. Optionally, the probes can be equipped with a calibration gas port, solenoid valves and a pressure vessel. The standard flanges for mounting are DN3" - 150 and DN65 PN6, other flanges are possible due to the maximum operating pressure.

#### Type code:

Item number IECEx GAS 222 Ex2

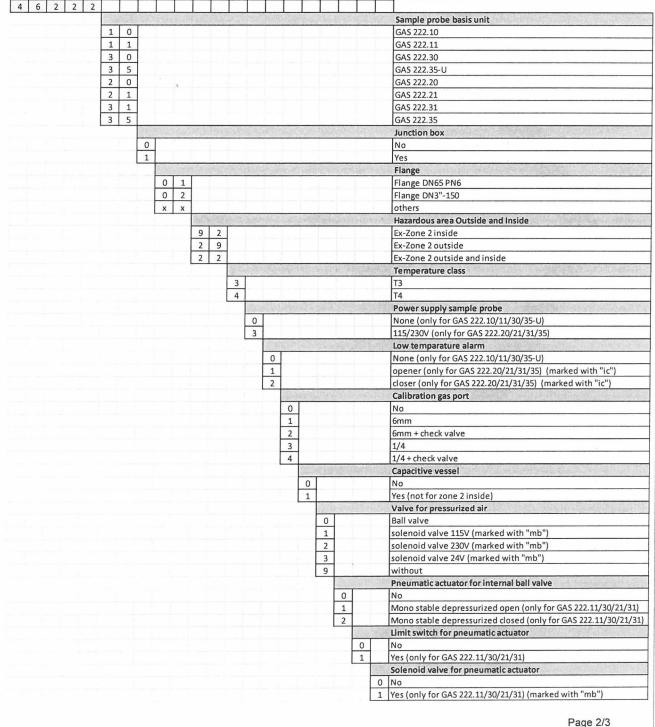

Intrinsically safe thermo alarm:

 $U_i = 30 V$ 

I<sub>i</sub> = 0.1 A

### [16] Test report

The test results are recorded in the confidential test report IB-16-3-053 of 2017-08-24. The test documents are part of the test report and they are listed there.

### Summary of the test results

The Sample Gas Probe of the type GAS 222.xx Ex2 fulfils the requirements of the type of protection increased safety "e" for explosion protected equipment of group II and category 3 G.

### [17] Specific conditions of use

The plug connector is to be installed and operated corresponding to the low risk of mechanical danger in accordance with IEC 60079-0.

High charge producing processes and manual rubbing must be prevented.

The sample gas probe can be used in an ambient temperature range of -20 °C up to +80 °C.

The plug connectors may only be used for fixed installation. The operating company must provide a suitable stress relief.

### [18] Essential health and safety requirements

In addition to the essential health and safety requirements (EHSRs) covered by the standards listed at item [9], the following are considered relevant to this product, and conformity is demonstrated in the test report: None

### [19] Drawings and Documents

The documents are listed in the test report.

IBExU Institut für Sicherheitstechnik GmbH Fuchsmühlenweg 7 09599 Freiberg, GERMANY

By order

1 House,

Dipl.-Ing. [FH] A. Henker

Freiberg, 2017-08-24

# [1] **TYPE EXAMINATION CERTIFICATE** - Translation

[2] Equipment of equipment-groups I and II, equipment-categories M2 and 2 plus 3



- [4] Product: Sample Gas Probe Type: GAS 222.xx Ex2
- [5] Manufacturer: Bühler Technologies GmbH
- [6] Address: Harkortstr. 29 40880 Ratingen GERMANY
- [7] This product and any acceptable variation thereto is specified in the schedule to this certificate and the documents therein referred to.
- [8] IBExU Institut für Sicherheitstechnik GmbH certifies that this product has been found to comply with the essential health and safety requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II to Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014.

The examination and test results are recorded in the confidential test report IB-21-3-0003.

- [9] Compliance with the essential health and safety requirements has been assured by compliance with: EN 60079-0:2012 + A11:2013 EN IEC 60079-7:2015/A1:2018 except in respect of those requirements listed at item [18] of the schedule.
- [10] If the sign "X" is placed after the certificate number, it indicates that the product is subject to the specific conditions of use specified in the schedule to this certificate.
- [11] This type examination certificate relates only to the design of the specified equipment and not to specific items of equipment subsequently manufactured or supplied.
- [12] The marking of the product shall include the following:

## 🐵 II 3G Ex ec ic mb IIC T3 or T4 Gc

Different variants of the marking can be marked on the unit and result from the type code.

IBExU Institut für Sicherheitstechnik GmbH Fuchsmühlenweg 7 09599 Freiberg, GERMANY

By order

Dipl.-Ing. [FH] A. Henker

IBExU Institut für Sicherheitstechnik GmbH Fuchsmühlenweg 7 09599 Freiberg/Sachsen Telefon (03731) 3805-0 Telefax (03731) 38 05 10 - Stamp - Tel: + 49 (0) 37 31 / 38 05 0 Fax: + 49 (0) 37 31 / 38 05 10

Certificates without signature and stamp are not valid. Certificates may only be duplicated completely and unchanged. In case of dispute the German text shall prevail.

Freiberg, 2021-03-09

[13]

[14]

## Schedule

## Certificate number IBExU17ATEXB007 X | Issue 1

## [15] Description of product

At the gas analysis the sampling point is a critical interface between the process and the analysis system. The probes are used to take gas samples from a sampling point. They can be unheated or heated. The probes are equipped with an in-situ filter or a downstream filter or with a combination of both. Some probes have an integrated shut off ball valve (manual or pneumatic) for the blowback of the filter. Optionally, the probes can be equipped with a calibration gas port, solenoid valves and a pressure vessel. The standard flanges for mounting are DN3" - 150 and DN65 PN6, other flanges are possible due to the maximum operating pressure.

Type code:	e code:
------------	---------

4 6 2 2 2	
	sample probe basis unit
10	GAS 222.10
1 1	GAS 222.11
3 0	GAS 222.30
3 5	GAS 222.35-U
20	GAS 222.20
2 1	GAS 222.21
3 1	GAS 222.31
3 5	GAS 222.35
	junction box
0	no
1	yes
	flange
0 1	flange DN65 PN6
0 2	flange DN3"-150
x x	others
	hazardous area outside and inside
9 2	Ex-Zone 2 inside
2 9	Ex-Zone 2 outside
2 2	Ex-Zone 2 outside and inside
	temperature class
3	Т3
4	Τ4
	power supply sample probe
0	none (only for GAS 222.10/11/30/35-U)
3	115/230V (only for GAS 222.20/21/31/35)
	low temparature alarm
0	none (only for GAS 222.10/11/30/35-U)
1	opener (only for GAS 222.20/21/31/35) (marked with "ic")
2	closer (only for GAS 222.20/21/31/35) (marked with "ic")
	calibration gas port
0	no

An-Instit	ut de	er T	ΓU	Bei	ga	h <b>eitstechnik GmbH</b> kademie Freiberg
	1					6mm
	2	1				6mm + check valve
	3	1				1/4
	4					1/4 + check valve
		<u>n n</u>				pressure vessel
		0				no
		1				yes
						purge valve
			0			ball valve
			1			solenoid valve 110V (marked with "mb")
			2			solenoid valve 230V (marked with "mb")
			3			solenoid valve 24V (marked with "mb")
			9			without
				電時		pneumatic actuator for internal ball valve
				0		no
				1		mono stable depressurized open (only for GAS 222.11/30/21/31)
				2		mono stable depressurized closed (only for GAS 222.11/30/21/31)
				1		limit switch for pneumatic actuator
				C		no
				1		yes (only for GAS 222.11/30/21/31)
						solenoid valve for pneumatic actuator
					0	no
					1	110V (only for GAS 222.11/30/21/31) (marked with "mb")
					2	230V (only for GAS 222.11/30/21/31) (marked with "mb")
					3	24V (only for GAS 222.11/30/21/31)

Intrinsically safe thermo alarm:  $U_{i} = 30 V$ 

 $l_i = 0.1 A$ 

Variation compared to issue 0 of this certificate:

Variation of type code

### [16] Test report

The test results are recorded in the confidential test report IB-21-3-0003 of 2021-02-18. The test documents are part of the test report and they are listed there.

## Summary of the test results

The Sample Gas Probe of the type GAS 222.xx Ex2 fulfils the requirements of the type of protection increased safety "e" for explosion protected equipment of group II and category 3G.

#### [17] Specific conditions of use

The plug connector is to be installed and operated corresponding to the low risk of mechanical danger in accordance with EN 60079-0.

High charge producing processes and manual rubbing must be prevented.

The sample gas probe can be used in an ambient temperature range of -20 °C up to +80 °C.

The plug connectors may only be used for fixed installation. The operating company must provide a suitable stress relief.

[18] Essential health and safety requirements

In addition to the essential health and safety requirements (EHSRs) covered by the standards listed at item [9], the following are considered relevant to this product, and conformity is demonstrated in the test report: None

[19] **Drawings and Documents** The documents are listed in the test report.

IBExU Institut für Sicherheitstechnik GmbH Fuchsmühlenweg 7 09599 Freiberg, GERMANY

By order

1. Hendel

Dipl.-Ing. [FH] A. Henker

Freiberg, 2021-03-09